


CAST IRON BOOT AND COVER, AS MANUFACTURED BY SIGMA CORPORATION, OR APPROVED EQUAL THE BOOT SHALL BE LARGE ENOUGH TO ACCOMMODATE AN 8" PIPE. CENTER CLEAN-OUT PLUG WITH CENTER OF BOOT OPENING

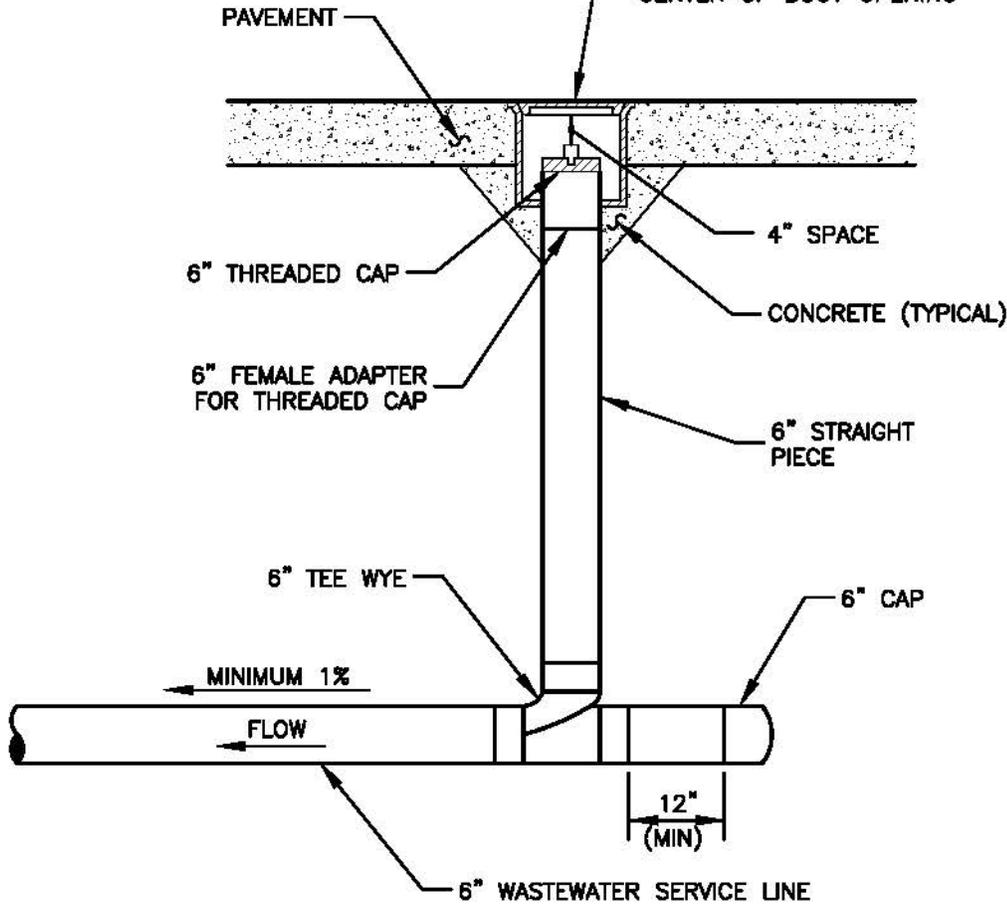

PROFILE VIEW

NOTES:

1. ALL PIPE TO BE SDR 26.
2. ALL FITTINGS TO BE SDR 35 SOLVENT WELD FITTINGS.

RECORD SIGNED COPY
ON FILE AT PUBLIC WORKS

APPROVED

12-01-10

DATE

THE ARCHITECT/ENGINEER ASSUMES
RESPONSIBILITY FOR THE APPROPRIATE
USE OF THIS DETAIL. (NOT TO SCALE)

CITY OF ROUND ROCK

**WASTEWATER SERVICE
CLEAN-OUT DETAIL
(PAVED SURFACES)**

DRAWING NO:
WW-13

