


NON-PAVED SURFACE:

(A) PROVIDE 6" OF TOPSOIL AND REVEGETATE

(B) PROVIDE COMPACTED BACKFILL IN SITU TRENCH MATERIAL FREE OF ROCK AND CLODS GREATER THAN 4", COMPACTED IN 6" LIFTS. COMPACTION TO 95% IN R.O.W. AND IN OR NEAR FLOOD PLAIN. OTHER LOCATIONS TO BE 85% (SEE SPEC. ITEM 510)

PROPOSED PAVED SURFACE:

SUBGRADE PREP, FLEXIBLE BASE AND H.M.A.C. PER PAVEMENT PLANS, UNDER SEPARATE PROCEDURE

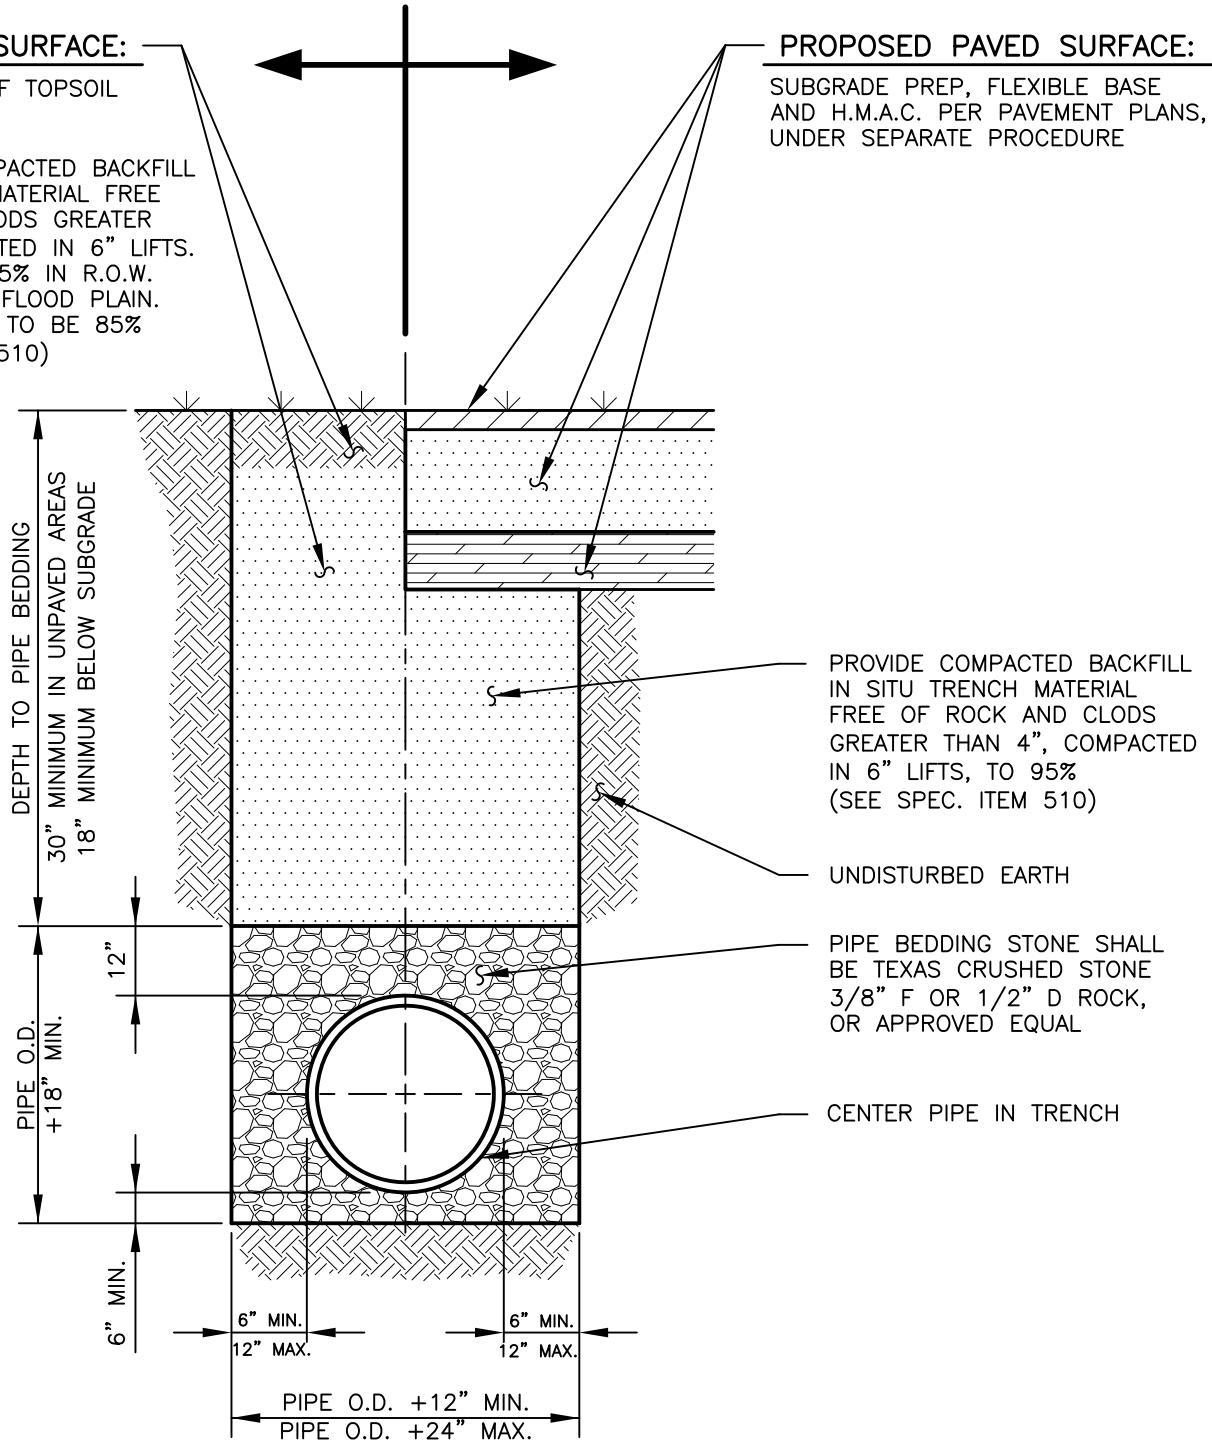

NOTE:

1. ALL TRENCHING AND TRENCH SAFETY SHALL COMPLY WITH APPLICABLE FEDERAL, STATE AND LOCAL REGULATIONS.

<p>RECORD SIGNED COPY ON FILE AT U&ES DEPARTMENT</p> <p>APPROVED</p> <p>03-01-18</p> <p>DATE</p> <p>THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR THE APPROPRIATE USE OF THIS DETAIL. (NOT TO SCALE)</p>
--

CITY OF ROUND ROCK

**WATERLINE BEDDING AND
SURFACE REPAIR DETAIL**

(NON-PAVED & PROPOSED PAVED SURFACE)

DRAWING NO:
WT-08