


NON-PAVED SURFACE:

(A) PROVIDE 6" OF TOPSOIL AND REVEGETATE

(B) PROVIDE COMPACTED BACKFILL IN SITU TRENCH MATERIAL FREE OF ROCK AND CLODS GREATER THAN 4", COMPACTED IN 6" LIFTS. COMPACTION TO 95% IN R.O.W. AND IN OR NEAR FLOOD PLAIN. OTHER LOCATIONS TO BE 85%. (SEE SPEC. ITEM 510)

PROPOSED PAVED SURFACE:

SUBGRADE PREP, FLEXIBLE BASE AND H.M.A.C. PER PAVEMENT PLANS, UNDER SEPARATE PROCEDURE

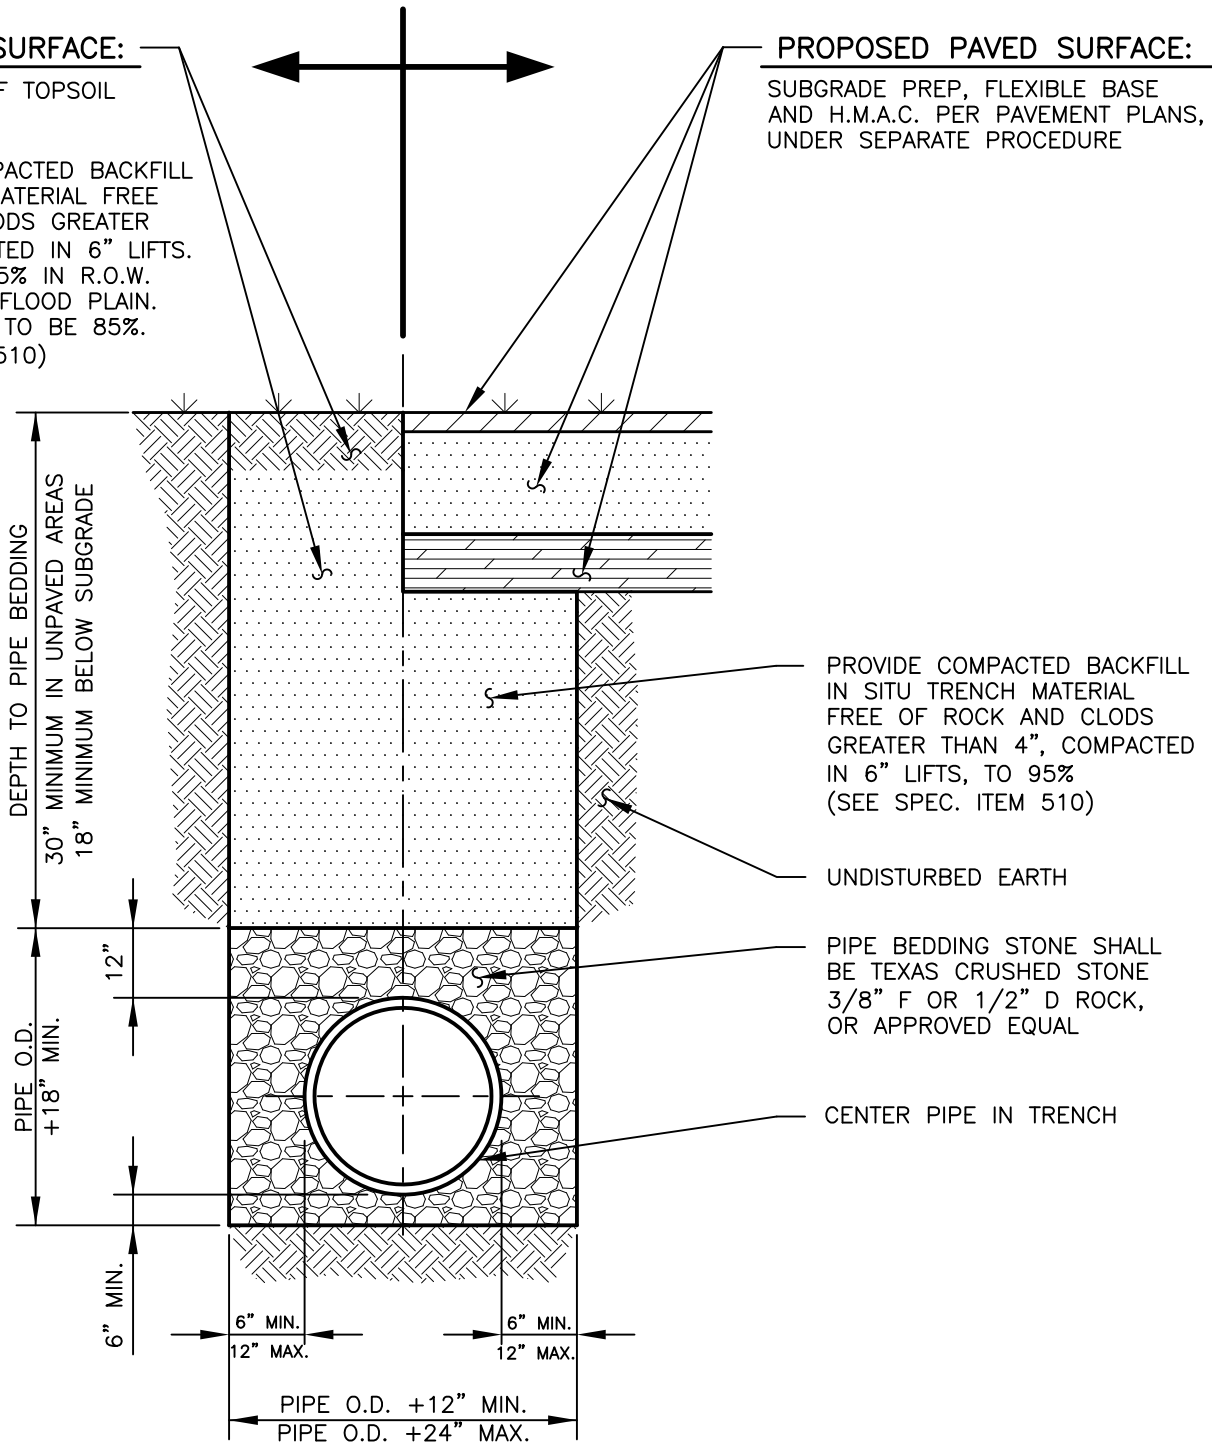

PROVIDE COMPACTED BACKFILL IN SITU TRENCH MATERIAL FREE OF ROCK AND CLODS GREATER THAN 4", COMPACTED IN 6" LIFTS, TO 95% (SEE SPEC. ITEM 510)

UNDISTURBED EARTH

PIPE BEDDING STONE SHALL BE TEXAS CRUSHED STONE 3/8" F OR 1/2" D ROCK, OR APPROVED EQUAL

CENTER PIPE IN TRENCH

NOTE:

ALL TRENCHING AND TRENCH SAFETY SHALL COMPLY WITH APPLICABLE FEDERAL, STATE AND LOCAL REGULATIONS.

RECORD SIGNED COPY ON FILE AT U&ES DEPARTMENT
APPROVED

03-01-18
DATE

THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR THE APPROPRIATE USE OF THIS DETAIL. (NOT TO SCALE)

CITY OF ROUND ROCK

**WASTEWATER LINE BEDDING AND SURFACE REPAIR DETAIL
(NON-PAVED & PROPOSED PAVED SURFACE)**

DRAWING NO:
WW-18

