


CONDUITS WITH FIBER OPTIC CABLE ARE TO BE PLACED VIA BORE OR TUNNELING UNDER THE CURB AND SIDEWALK TO THE 10" X 15" SERVICE DROP VAULT. ALL BORE/TUNNELING OPERATIONS SHALL BE FLOWABLE FILLED TO ELIMINATE ANY VOIDS OR GAPS. REFER TO THE 6" MAXIMUM ASPHALT CORE WINDOW IN ROADWAY. FIBER CABLE(S) SHALL NOT BE DIRECT BURIED.

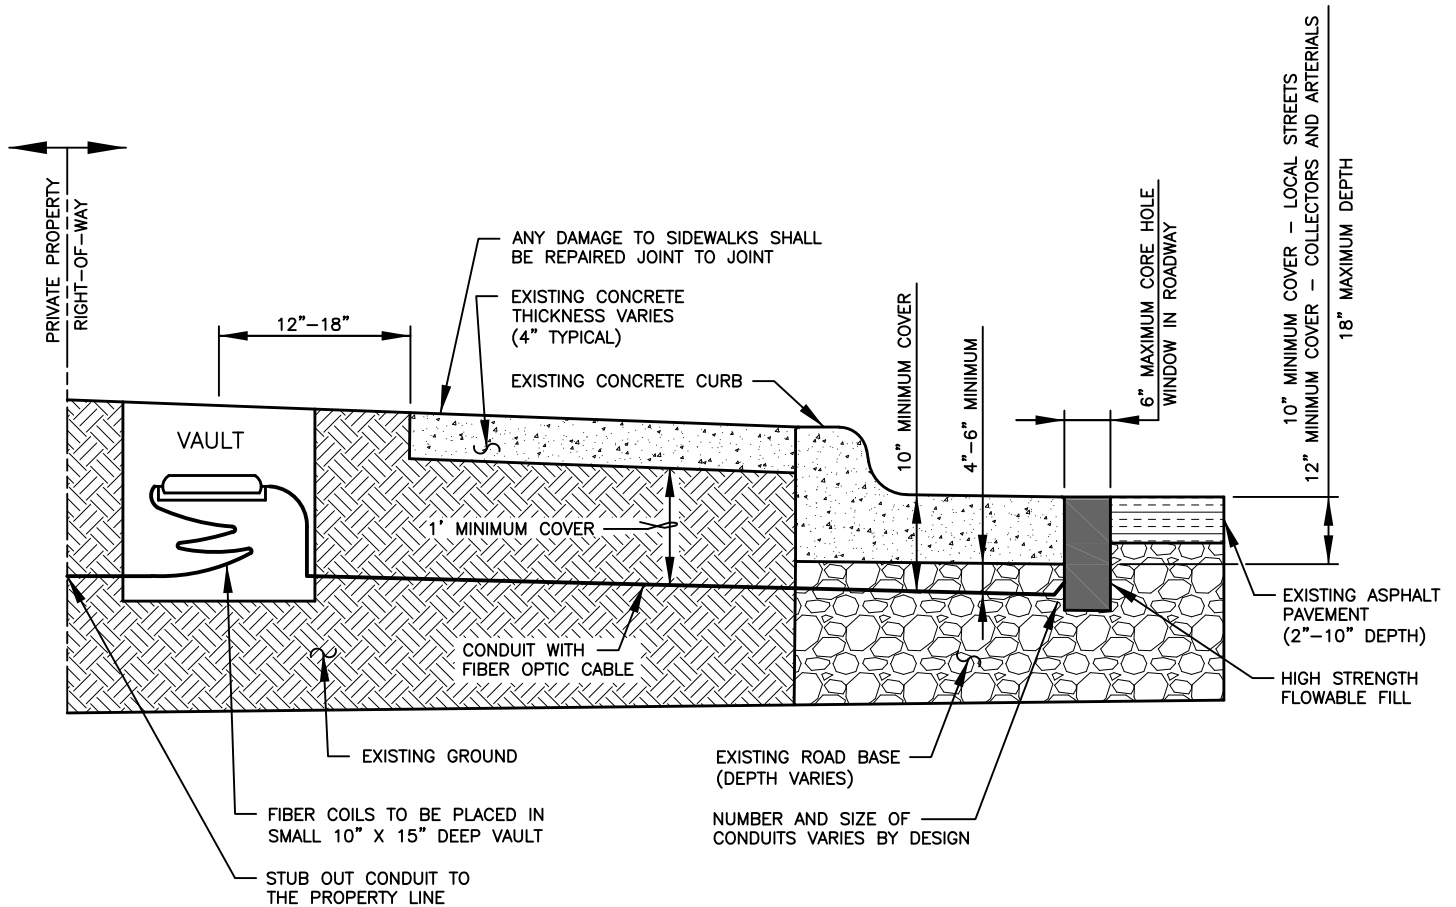

#### NOTES:

1. ALL FUTURE SERVICE DROPS SHALL BE EXTENDED TO THE RIGHT-OF-WAY PROPERTY LINE WITH OR WITHOUT A SIDEWALK.
2. ALL VAULTS SHALL BE PLACED, SAFETY FENCED AND COMPLETELY BACKFILLED WITHIN 14 DAYS. RESTORATION OF ALL DISTURBED AREAS SHALL MATCH EXISTING CONDITIONS OR GREATER.
3. NO MANHOLES, HAND HOLES, VAULTS OR MARKERS SHALL BE INSTALLED IN ANY SIDEWALKS, ADA RAMP OR DRIVEWAYS.
4. THE NEW DROP VAULTS SHALL BE 3'-5' AWAY FROM EXISTING CITY OF ROUND ROCK WATER SERVICE METERS AND WASTEWATER SERVICE CLEAN-OUTS.
5. THE CONTRACTOR SHALL BE RESPONSIBLE FOR LOCATING AND VERIFYING EXISTING WATER, WASTEWATER AND STORM SEWER LINES/SERVICES PRIOR TO ANY EXCAVATING. THE CONTRACTOR SHALL WALK THE PROPOSED MICRO-TRENCH AREA(S) WITH THE CITY INSPECTOR PRIOR TO ANY TRENCHING OPERATIONS.

RECORD SIGNED COPY  
ON FILE AT PUBLIC WORKS

APPROVED

06-01-25

DATE

THE ARCHITECT/ENGINEER ASSUMES  
RESPONSIBILITY FOR THE APPROPRIATE  
USE OF THIS DETAIL. (NOT TO SCALE)

CITY OF ROUND ROCK

MICRO-TRENCH LATERAL SERVICE  
INSTALLATION - CURB TUNNEL  
BORES DETAIL

DRAWING NO:  
MT-02

