


DIRECTIONAL BORE PARALLEL TO THE STREET BEHIND THE CURB IN THE SOFT SCAPE IS 2" MAXIMUM DIAMETER AND IS 24" TO 36" IN DEPTH. CONDUITS WILL BE 1" TO 2" HIGH DENSITY POLYETHYLENE (HDPE). THE CONDUITS AND VAULTS WILL NEED TO BE 12" TO 18" OFF THE BACK OF CURB UNLESS A SIDEWALK EXISTS ABUTTING THE CURB, THEN VAULTS WILL BE AT THE REAR OF THE SIDEWALK. IF NO CURB AND GUTTER OR SIDEWALK EXISTS, CONDUITS/VAULTS WILL BE PLACED AT 36" FROM EDGE OF EXISTING PAVEMENTS UNLESS PLACEMENT IS OUT OF THE RIGHT-OF-WAY OR CONFLICTS WITH EXISTING UTILITIES MINIMUM OFFSET REQUIREMENTS. ANY QUESTIONS ON PLACEMENT SHALL BE DISCUSSED WITH THE ASSIGNED CITY INSPECTOR PRIOR TO ANY WORK. RESTORATION OF AREA(S): CLEAN UP, BACKFILL AND RESEEDING WILL BE REQUIRED UPON COMPLETION.

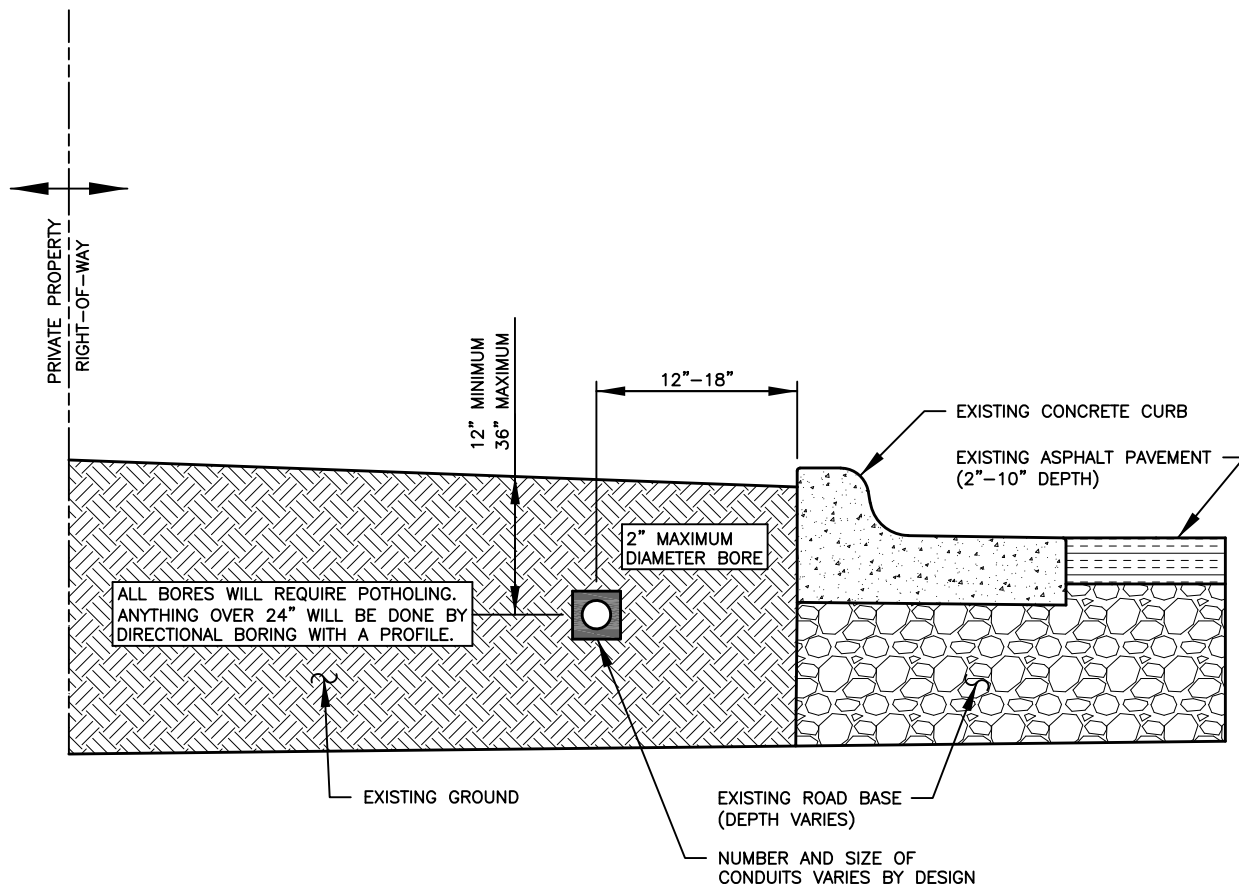

NOTES:

1. THE CONTRACTOR WILL BE RESPONSIBLE TO LOCATE AND VERIFY DEPTHS OF EXISTING WATER, WASTEWATER AND STORM SEWER LINES/SERVICES PRIOR TO EXCAVATING. THE CONTRACTOR SHALL WALK THE PROPOSED SOFT SCAPE AREA WITH THE ASSIGNED CITY INSPECTOR PRIOR TO ANY OPERATIONS.
2. ALL VAULTS SHALL BE PLACED, SAFETY FENCED AND COMPLETELY BACKFILLED WITHIN 14 DAYS. RESTORATION OF ALL DISTURBED AREAS SHALL MATCH EXISTING CONDITIONS OR GREATER.
3. NO MANHOLES, HAND HOLES, VAULTS OR MARKERS SHALL BE INSTALLED IN ANY SIDEWALKS, ADA RAMPS OR DRIVEWAYS.
4. ALL MANHOLES, VAULTS, HAND HOLES ETC. SHALL BE 3' TO 5' AWAY FROM CITY OF ROUND ROCK WATER SERVICE METERS AND WASTEWATER SERVICE CLEAN-OUTS.
5. ANY DAMAGE CAUSED FROM CONSTRUCTION ACTIVITIES TO EXISTING SIDEWALKS, CURBS, ADA RAMPS, DRIVEWAYS OR ROADWAY SURFACES SHALL BE REPAIRED AT THE CONTRACTORS EXPENSE.

RECORD SIGNED COPY
ON FILE AT PUBLIC WORKS

APPROVED

06-01-25

DATE

THE ARCHITECT/ENGINEER ASSUMES
RESPONSIBILITY FOR THE APPROPRIATE
USE OF THIS DETAIL. (NOT TO SCALE)

CITY OF ROUND ROCK

MICRO-TRENCH DEVIATION TO
SOFT SCAPE DEPLOYMENT BORE
DETAIL

DRAWING NO:
MT-03

